

ACCEPTABLE CURB BOXES


1. A.Y. McDONALD 5614
2. FORD EM-2-xx-57
3. MUELLER H-10300
4. OR APPROVED EQUAL.

ACCEPTABLE CURB STOPS

1. A.Y. McDONALD 76104
2. FORD B22-xxxM-NL
3. MUELLER B-25154N
4. OR APPROVED EQUAL.

ACCEPTABLE CORPORATION STOPS

1. A.Y. McDONALD 74701-B
2. FORD FB600-NL
3. MUELLER B-25000N
4. OR APPROVED EQUAL.

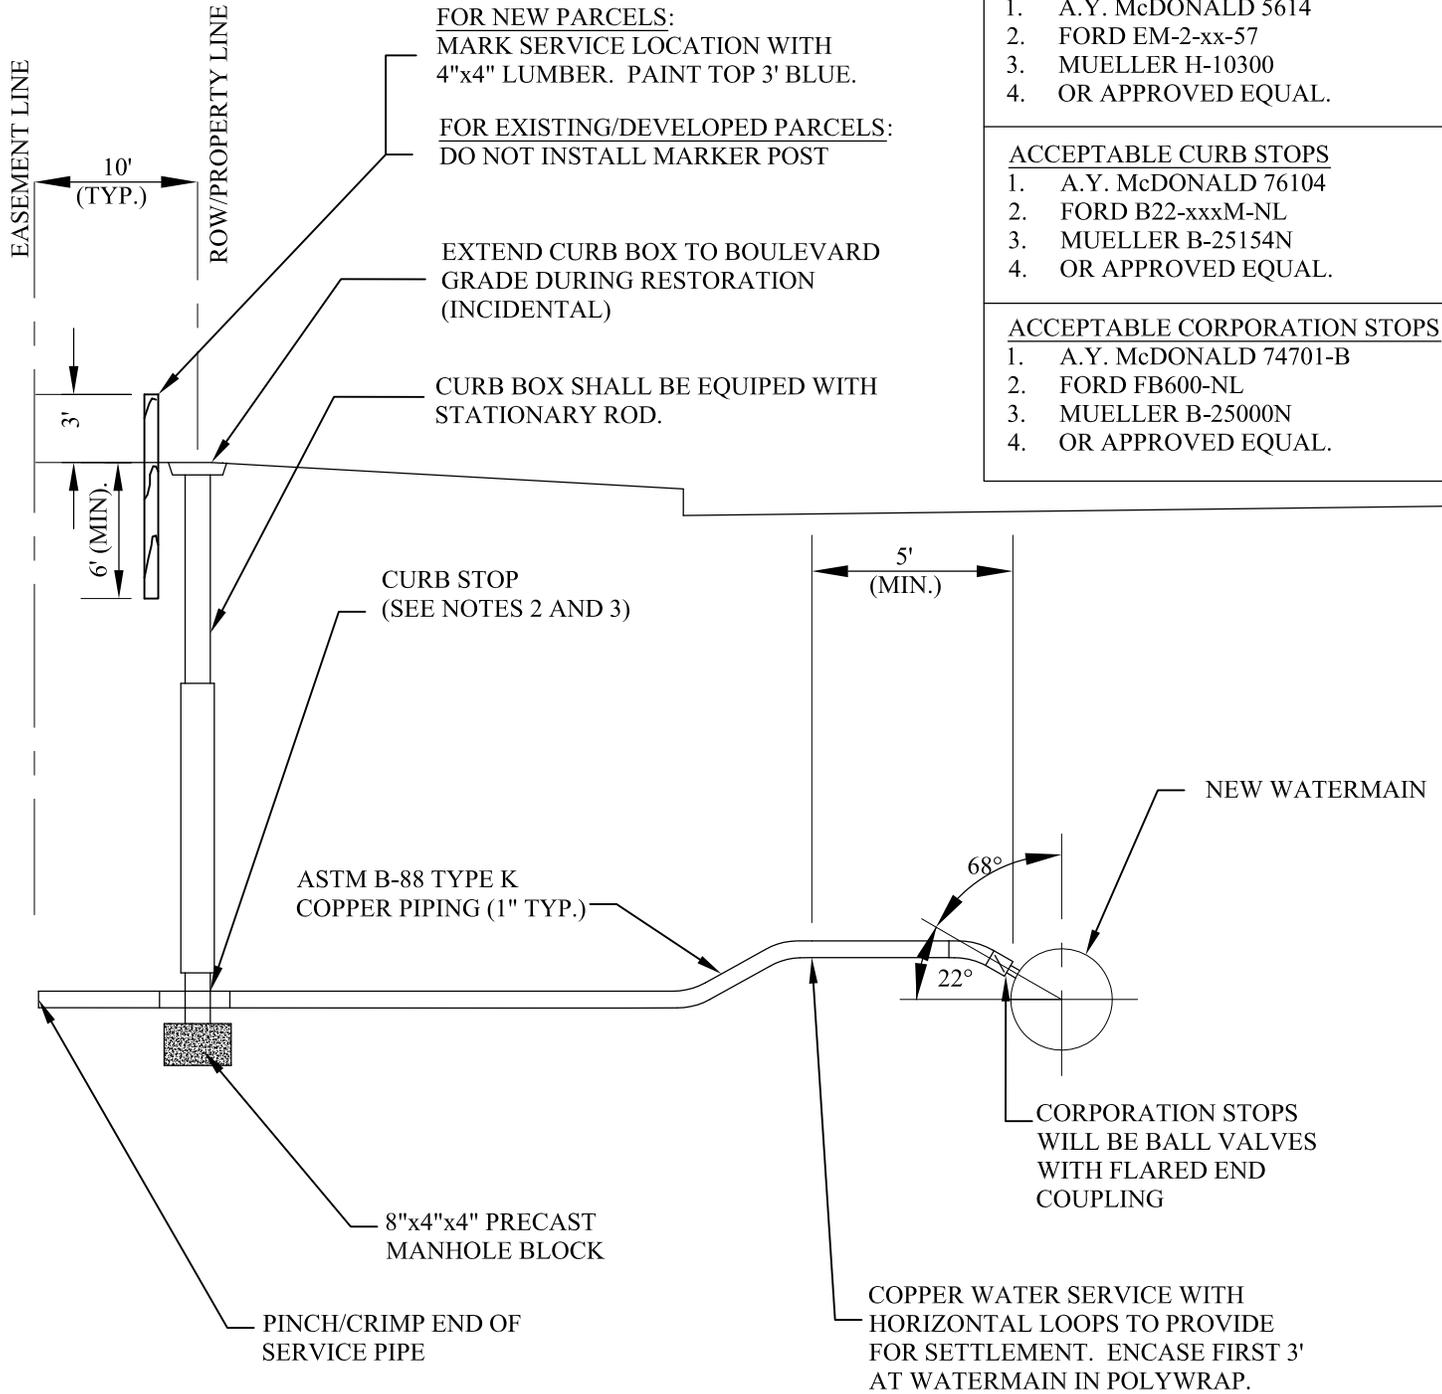

NOTES

1. MAINTAIN 18" VERTICAL AND 24" HORIZONTAL SEPARATION BETWEEN SEWER AND WATER SERVICE LINES.
2. CURB STOP WILL HAVE A SCREWED CONNECTION BETWEEN STOP AND BOX.
3. CURB STOP WILL USE FLARED END COUPLINGS ON BOTH ENDS.



CITY OF BURNSVILLE - ENGINEERING DEPT.  
**NEW WATER  
 SERVICE INSTALLATION**

Plate No.	WM-4
Revision Date	11/2013
File Location: S:\Details\english\Watermain\WM04-11InchS Service.dwg	